
A3 THIS DRAWING IS CORRECT WHEN PRINTED IN COLOUR AND TO THE SIZE INDICATED ON DRAWING BORDER.

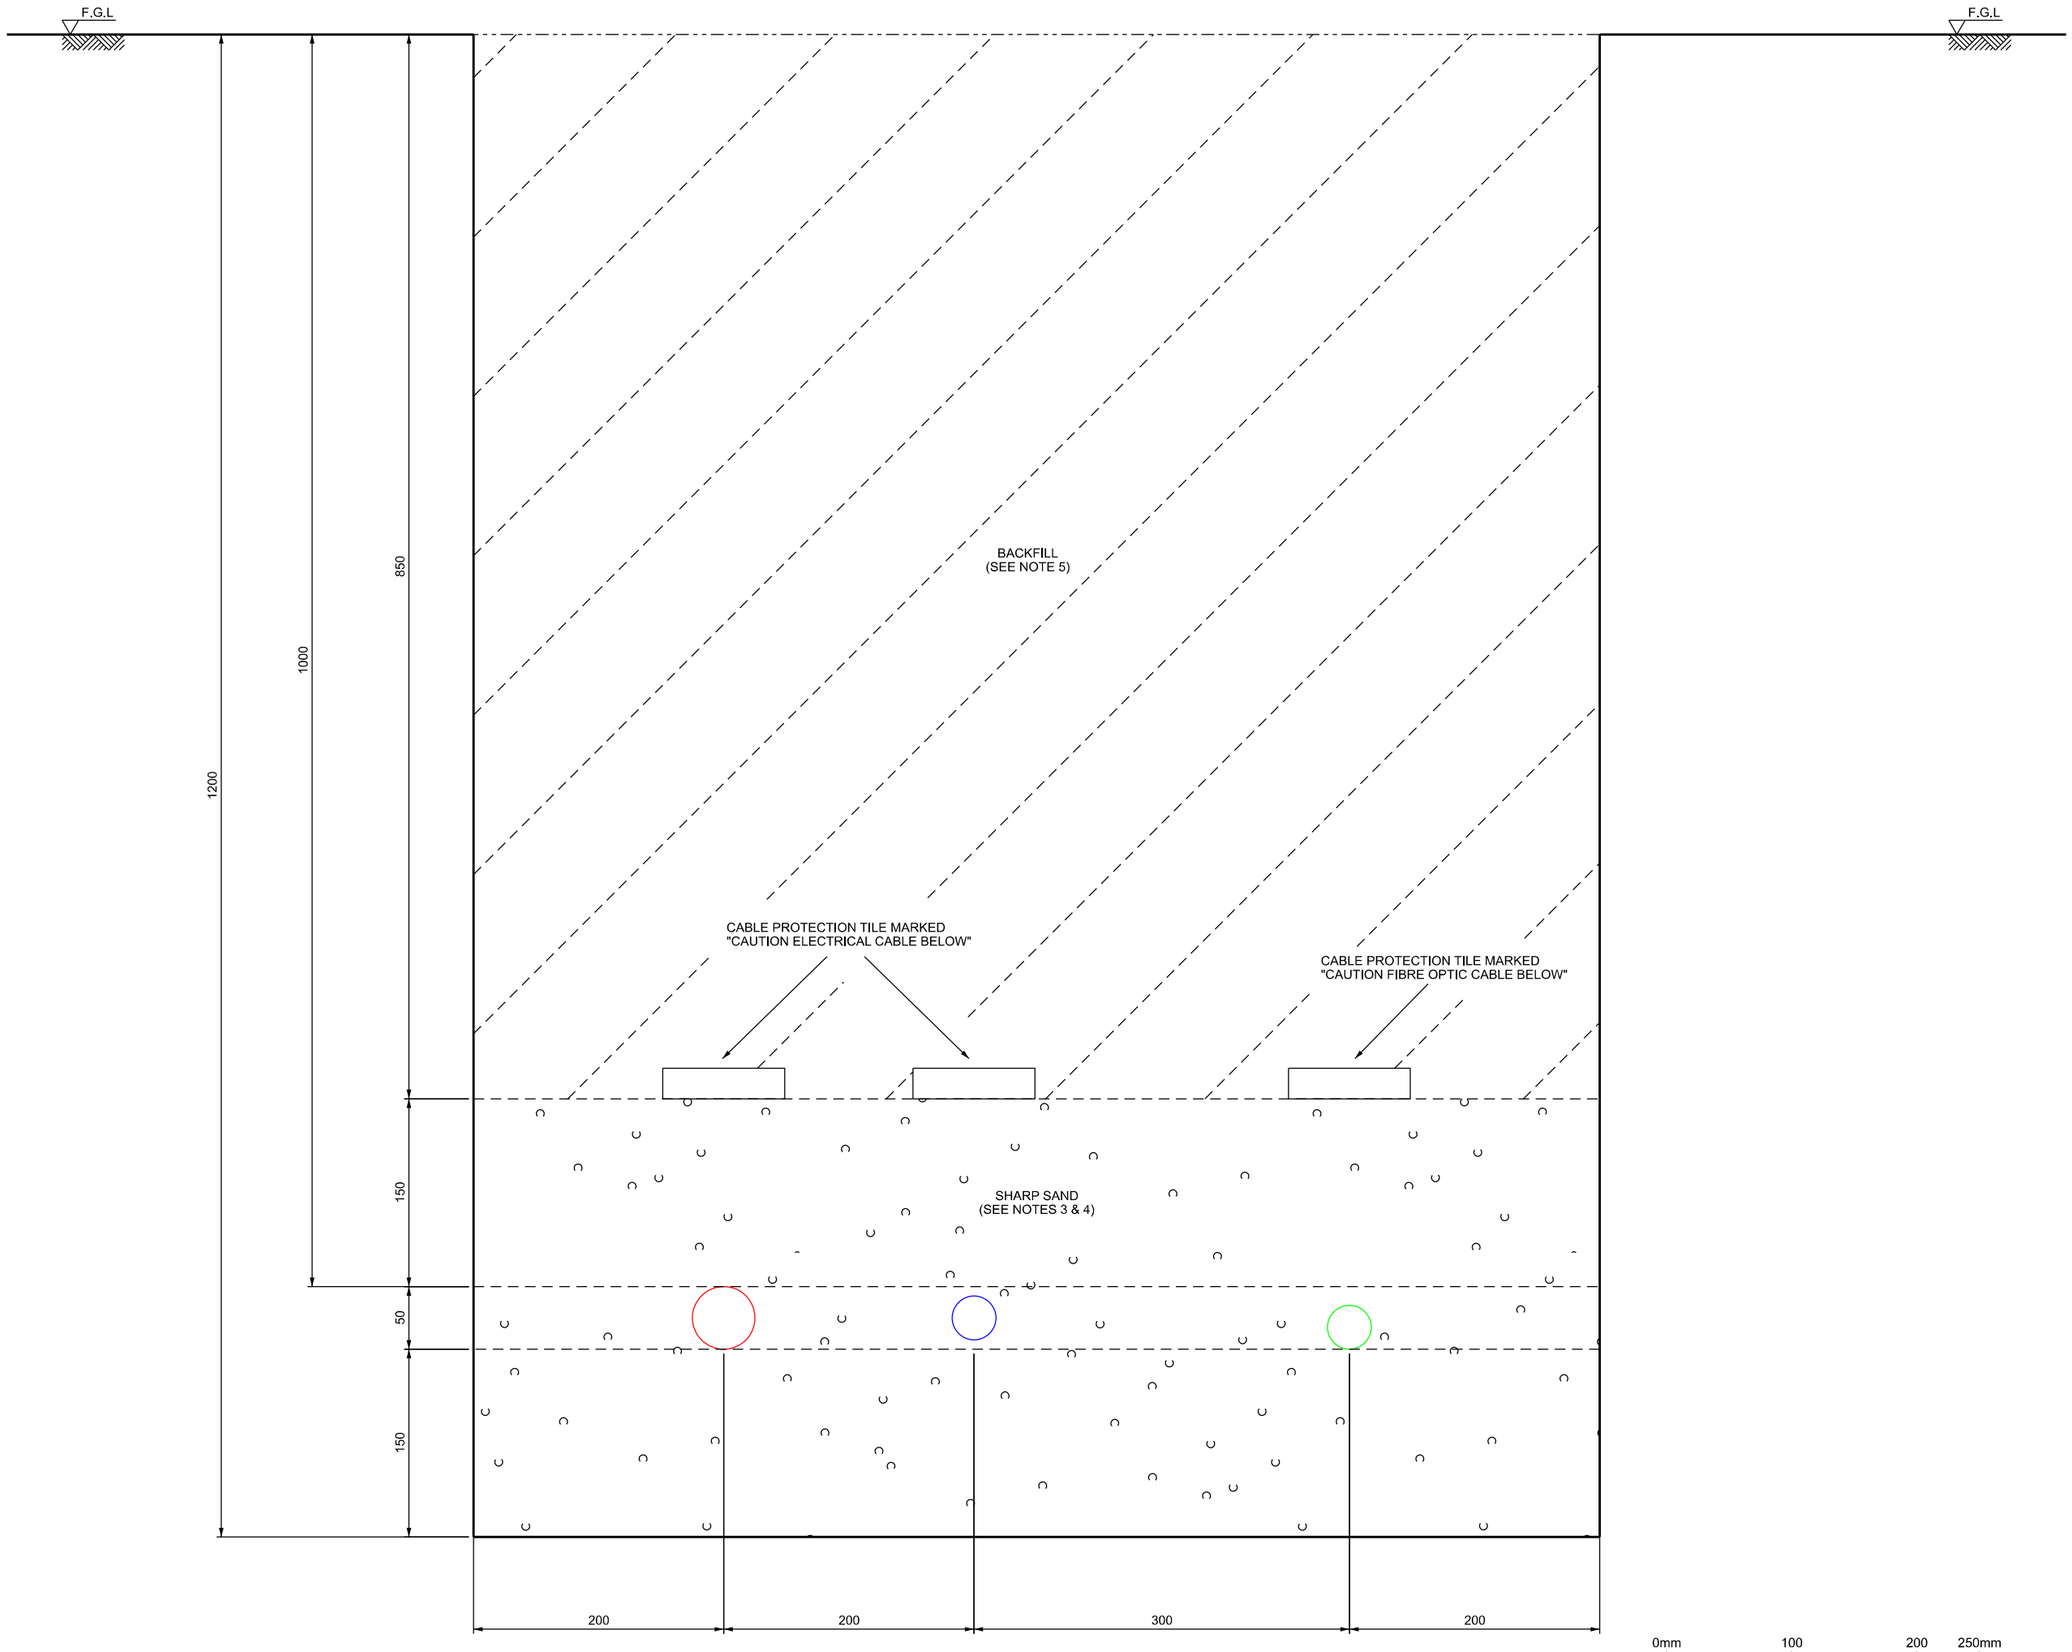

0mm 100 200 250mm
MILLIMETRES

PRELIMINARY ISSUE FOR DISCUSSION ONLY

REVISIONS:

REV	DESCRIPTION	DATE	CHK	APP
A	INITIAL ISSUE	06/04/23	MF	AC

NOTES

1. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
2. MINIMUM CABLE DEPTH THROUGH AGRICULTURAL LAND IS 1000mm.
3. ALL CABLES ARE TO BE LAID ON A BED OF SHARP SAND 150mm DEEP.
4. ALL CABLES ARE TO BE COVERED IN SHARP SAND 150mm DEEP.
5. BACKFILL WITH EXISTING SPOIL / TOP SOIL ENSURING THAT ALL LARGE STONES ARE REMOVED.

KEY

- 33Kv CABLE
- 400v CABLE
- FIBRE OPTIC COMMS CABLE
- SHARP SAND
- BACKFILL

CLIENT:
GROSVENOR FARMS LIMITED

PROJECT:
GROSVENOR FEED STUDY

TITLE:
CABLE TRENCH LAYOUT
FROM SPEN SUBSTATION
TO TRANSFORMER COMPOUND
(SHEET 1 OF 4)

SCALE: **1:5** @ A3 DRAWN: **TF**
CHECKED: **MF** CAD: DATE: **06/04/2023**
APPROVED: **AC** SHEET: **1** OF **4**

PROJECT No: **904**

DRAWING No: **904-01-BMDR-010**

REVISION: **A**

cng services ltd
VIRGINIA HOUSE
56 WARWICK ROAD
OLTON
SOLIHULL
B92 7HX
TEL: 0121 2478160
WEB: www.cngservices.co.uk

COPYRIGHT © 2011-2023
CNG SERVICES LTD